

July 2017 E. Coli Results



Massachusetts State Water Quality Standard
 Bacteria: Class B Waters
 No single sample shall exceed 235 *E. coli*
 Geometric mean of samples taken over the last 6 months (min. 5) shall not exceed 126 *E. coli*



Bacteria Results


E. coli

- 10 - 31
- 32 - 124
- 125 - 234
- 235 - 1000
- 1001 - 12000

— 100K Neponset Streams

■ 100K Neponset Ponds

□ Neponset Watershed

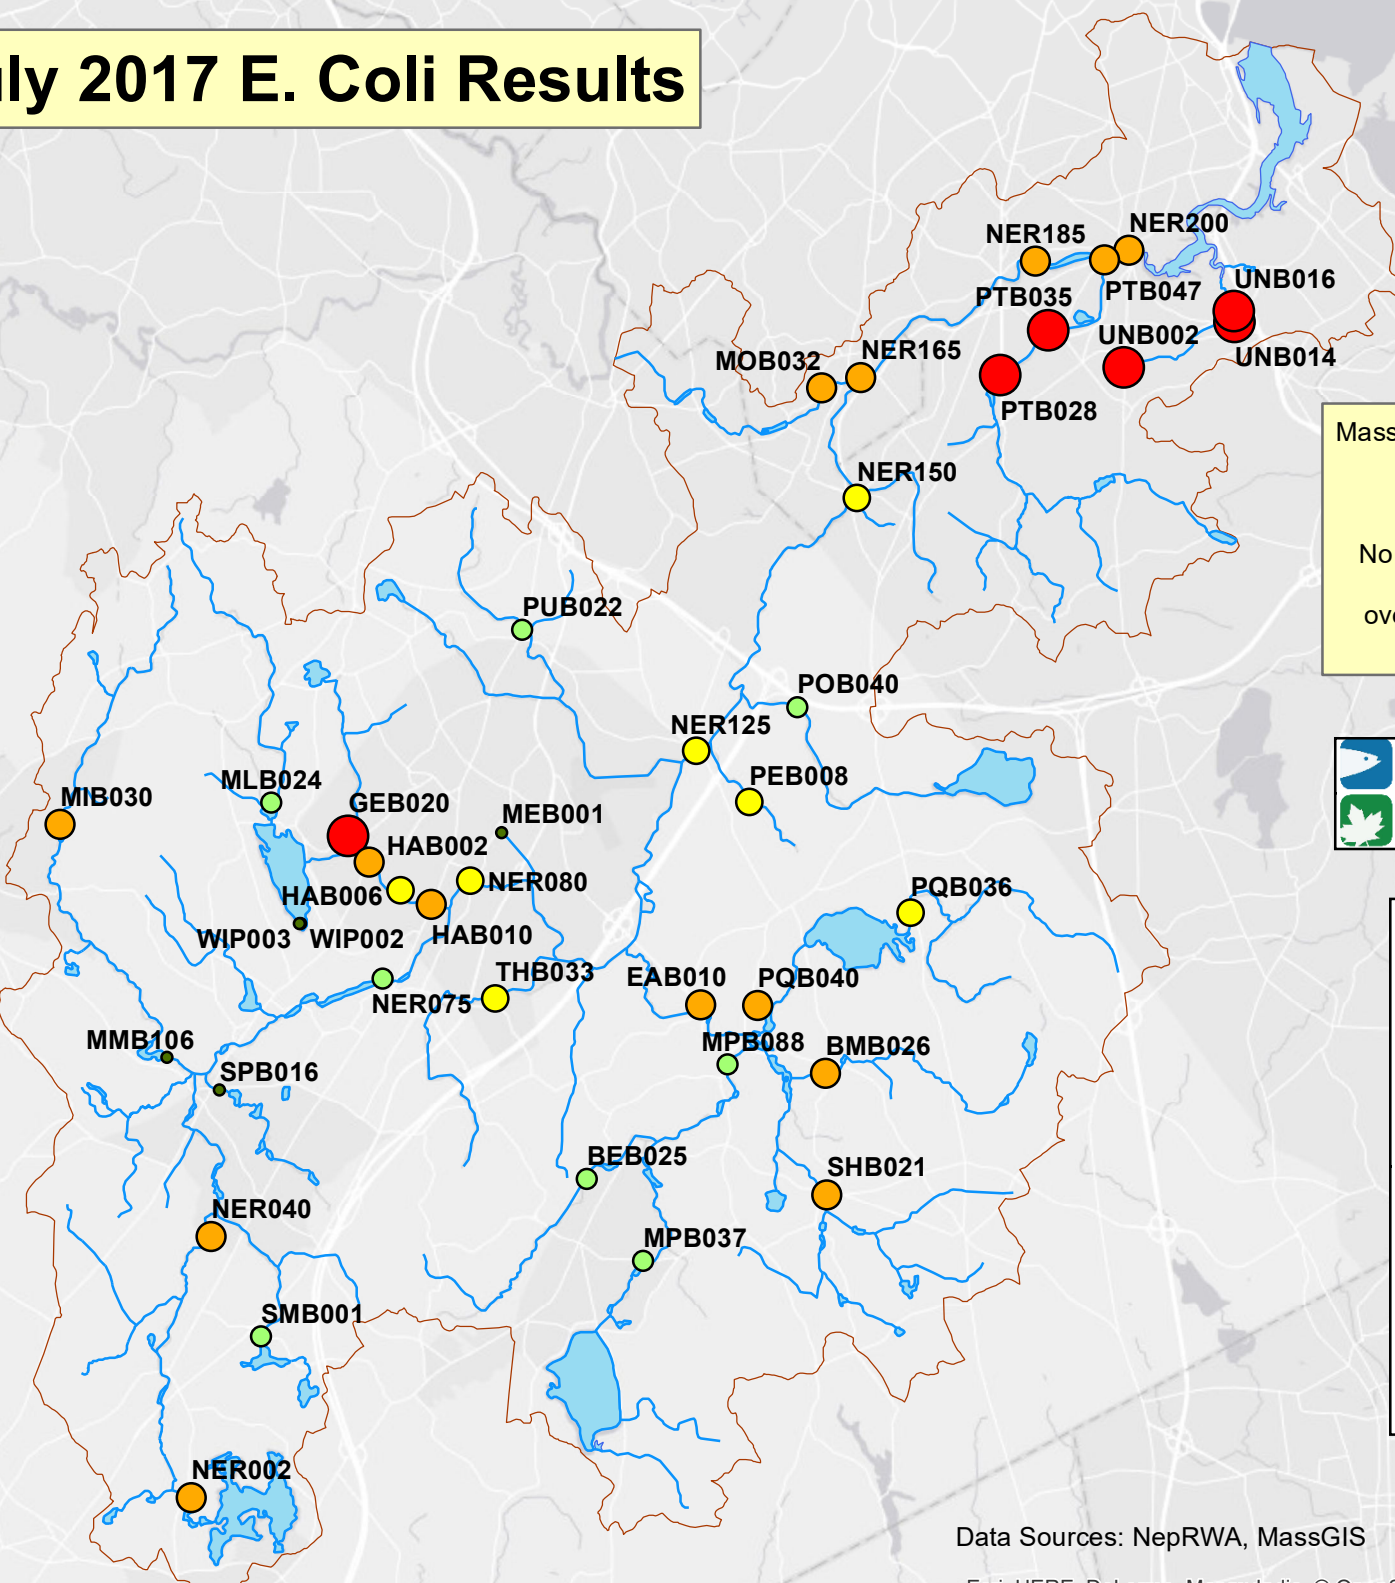

Data Sources: NepRWA, MassGIS

0 0.5 1 2 3 4 Miles