

October 2017 E. Coli Results



Massachusetts State Water Quality Standard

Bacteria: Class B Waters

No single sample shall exceed 235 *E. coli*
 Geometric mean of samples taken over the last 6 months (min. 5) shall not exceed 126 *E. coli*




Bacteria Results

E. coli

- 10 - 41
- 42 - 124
- 125 - 234
- 235 - 1000
- 1001 - 4880

- 100K Neponset Streams
- 100K Neponset Ponds
- Neponset Watershed

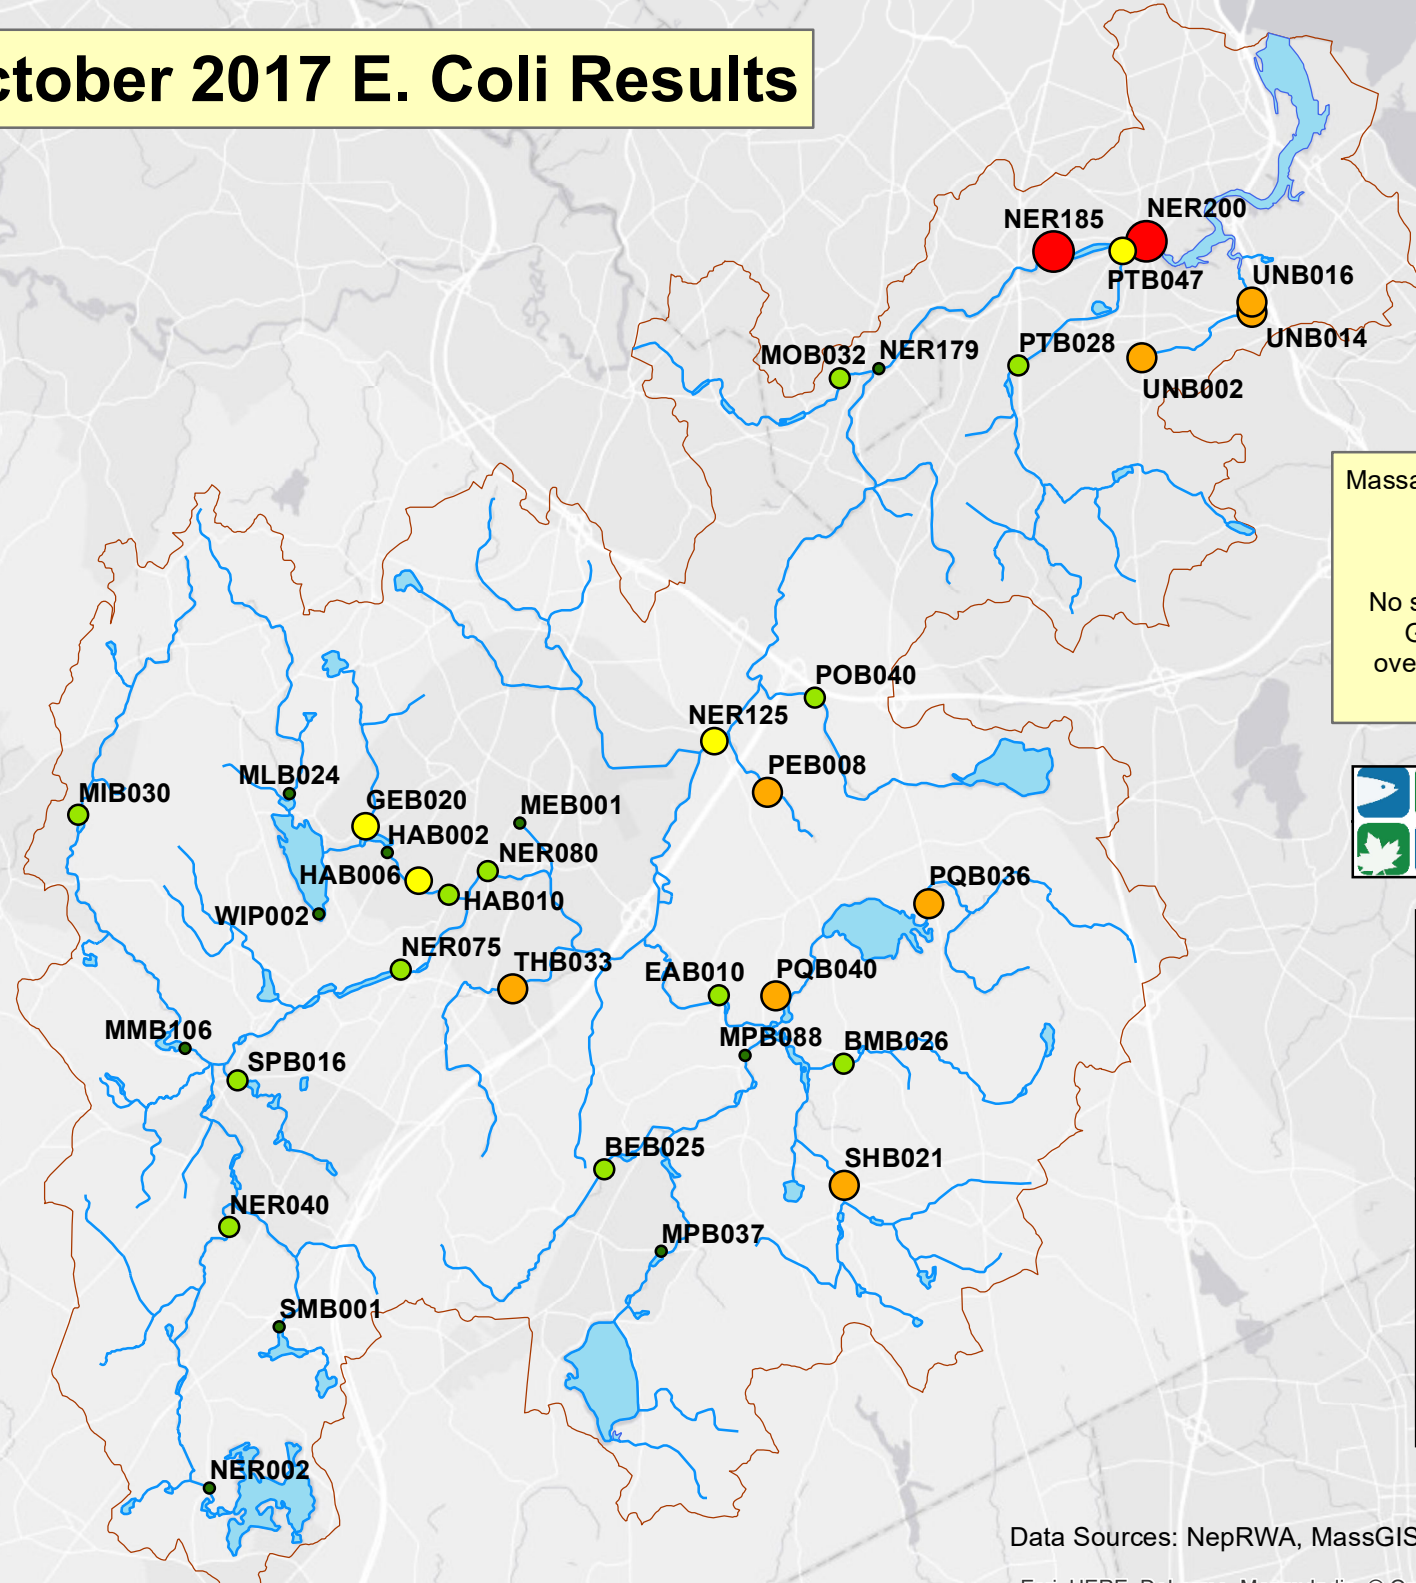

Data Sources: NepRWA, MassGIS

