

May 2017 E. Coli Results



Massachusetts State Water Quality Standard

Bacteria: Class B Waters

No single sample shall exceed 235 *E. coli*
 Geometric mean of samples taken over the last 6 months (min. 5) shall not exceed 126 *E. coli*



Bacteria Results


Bacteria

- 10 - 31
- 32 - 124
- 125 - 234
- 235 - 630
- 631 - 2600

— 100K Neponset Streams

— 100K Neponset Ponds

— Neponset Watershed

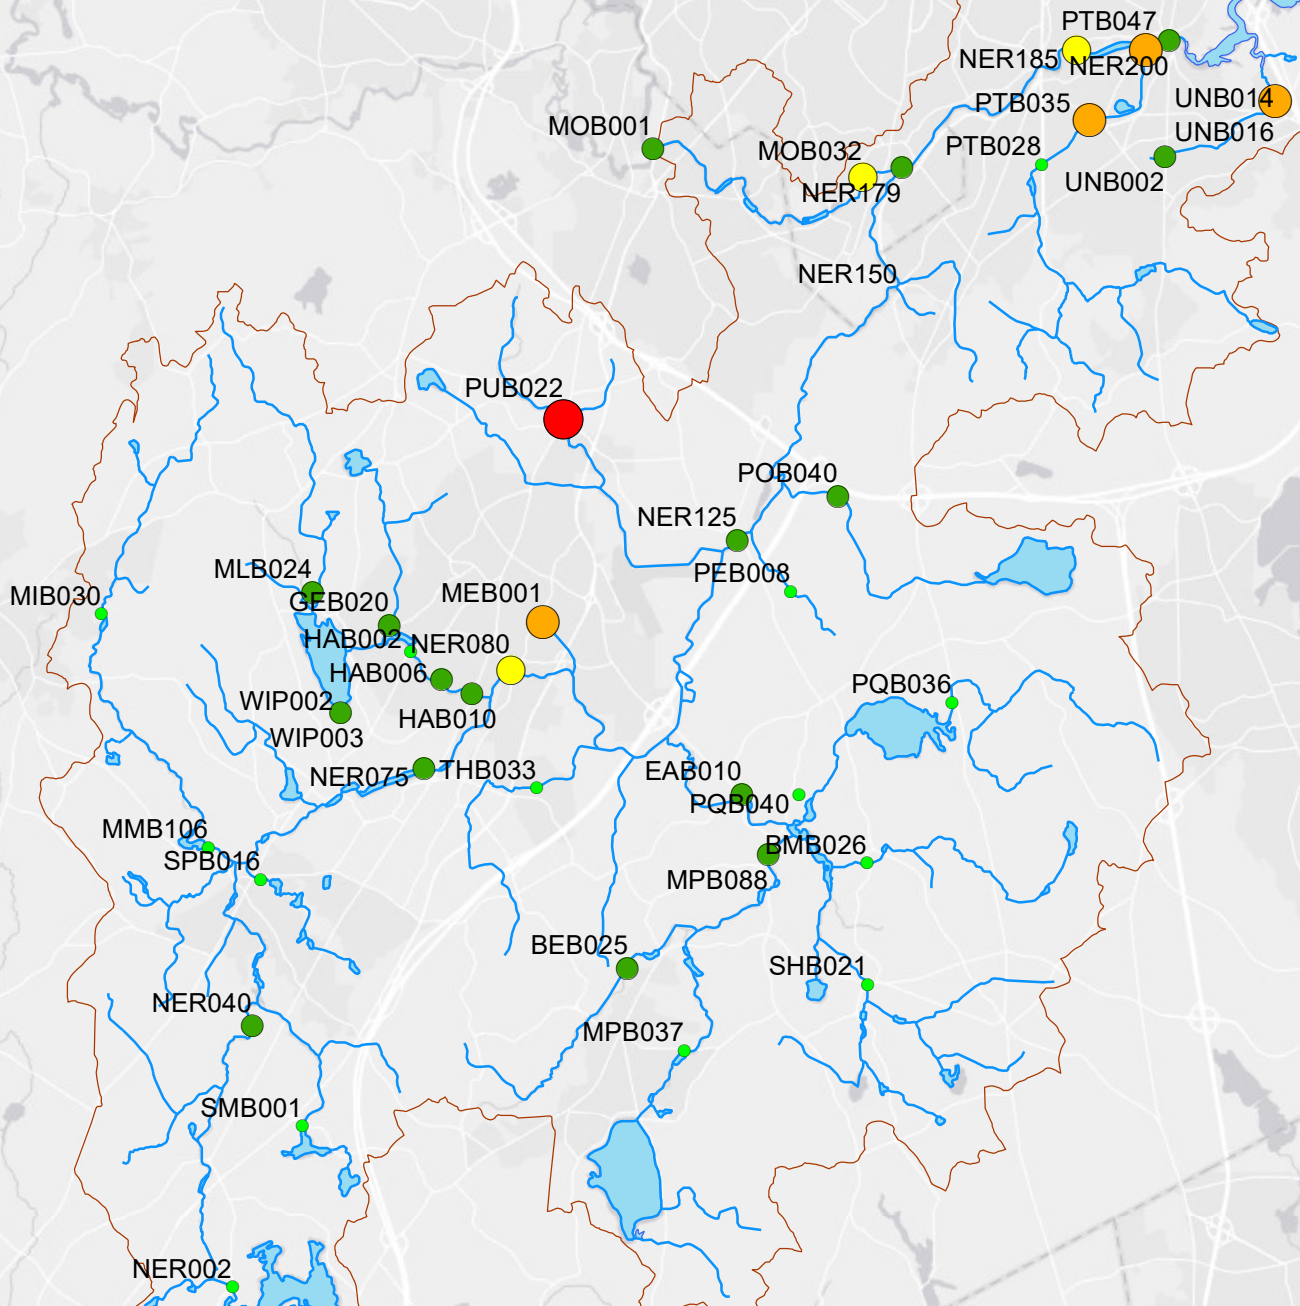

Data Sources: NepRWA, MassGIS

